




Application Guide



WATER TUBE BOILERS

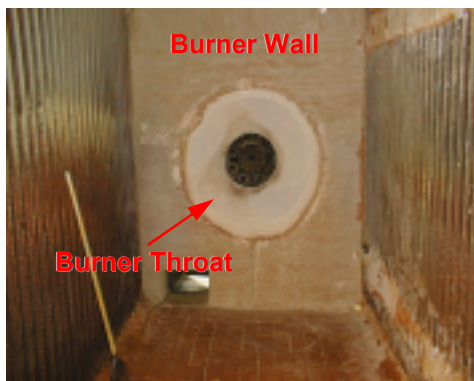

Burner Throat
Normal Service
 Plibrico Super F AB
High Duty Service
 Plibrico 60 AB
Severe Service
 Plibrico 85 S Special

Burner Wall
Normal Service
 Plicast Tuff Mix
 Plibrico Super F AB
High Duty Service
 Plicast 31
Severe Service
 Plicast KL 3000
 Plibrico 60 AB

Refractory Seal
 Plicast Trowl Mix




Tangent Tube (backup)
Normal Service
 Plicast Airlite
High Duty Service
 Plicast LWI 20
Severe Service
 Plicast Trowl Mix Plus KK
 Plisulate 1900 Block


Boiler Floor
Normal Service
 Plicast Tuff Mix
High Duty Service
 Plicast 31
Severe Service
 Plicast KL 3000

Application Note


Plibrico Water Tube Boiler Monolithic Refractory Details

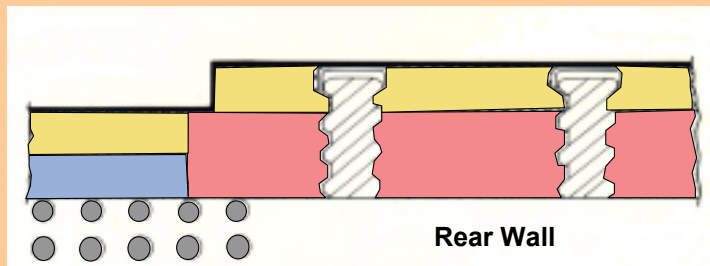


Convection Section

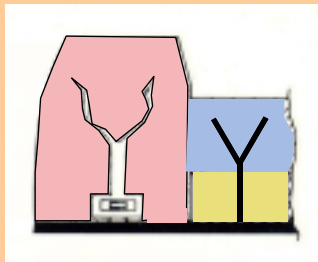

Burner Front Wall

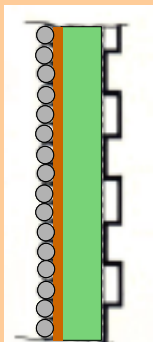

Tangent Tube Wall

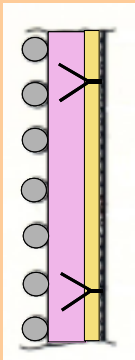

F.S. Sperry Co., Inc.
 1907 Vanderhorn Drive
 Memphis, TN. 38134

 Tel: 901-373-9000
 Fax: 901-385-3272

www.fssperry.com

This application guide is intended for general information only. Please consult Plibrico Company or your local Plibrico Representative for specific application assistance and product recommendations.